


HPLC

Order ID USCLTB5004896
Lot. No TB500311 - TB500671
Pump A 0.1% trifluoroacetic in 100% water
Pump B 0.1% trifluoroacetic in 100% acetonitrile
Total Flow 0.8ml/min
Wavelength 220nm
Analytical column type Phenomenex Luna 3u C18 (2) (4.6*150mm*3um)
Dissolution method 100% H₂O
Acquisition Time 7/6/2026
Inj. Volume 30ul

Time	Module	Action	Value
0.01	Pumps	B.Conc	15
25	Pumps	B.Conc	30
30	Pumps	B.Conc	90
31	Controller	Stop	

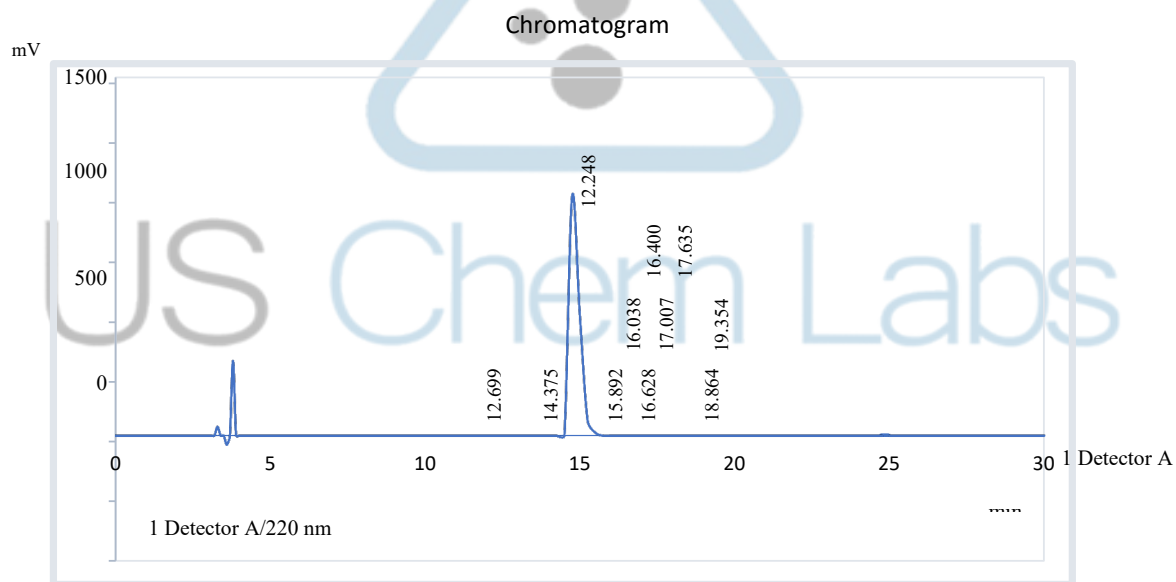

PeakTable

Detector A 220nm

Peak#	Ret. Time	Area	Height	Area %
1	12.669	10223	1640	0.059
2	14.375	3645	493	0.026
3	15.248	14045306	1000834	99.011
4	15.492	21433	3191	0.151
5	16.038	28188	2693	0.199
6	16.4	54089	6983	0.385
7	16.628	9888	972	0.070
8	17.007	2589	259	0.018
9	17.635	6670	890	0.047
10	18.864	2940	329	0.021
11	19.354	1939	275	0.014
Total		14186910	1018559	100.000



US Chem Labs